


FIREFIGHTER SAFETY WARNING SIGNS

FOR STRUCTURES WITH LIGHT-FRAME TRUSS-TYPE CONSTRUCTION

IN ACCORDANCE WITH FLORIDA ADMINISTRATIVE CODE 69A-3.012

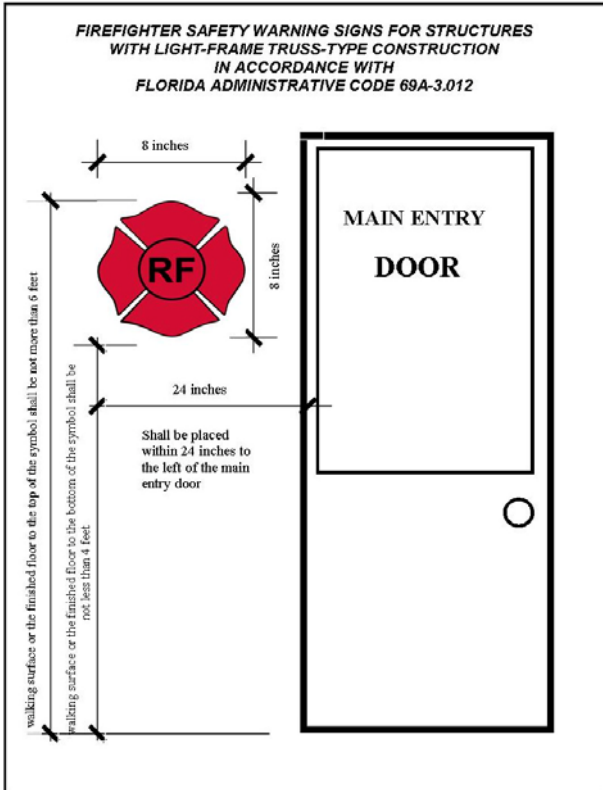

1. Symbols must be all weather proof and in contrasting color with background.
2. Maltese Cross shall measure 8 inches horizontally and 8 inches vertically.
3. Maltese Cross shall be a bright red reflective color.
4. Maltese Cross shall be within 24 inches to the left of the main entry.
5. Maltese Cross shall be not less than 4 feet above grade, walking surface, finished floor.
6. Maltese Cross shall be not more than 6 feet above grade, walking surface, finished floor.
7. Additional signs to be installed as determined by the Authority having jurisdiction.
8. The complete rule is available on the State Fire Marshal's web site under Rules of the State Fire Marshall at www.mycfo.com/sfm.
9. Single family residential property is not included in this statute.

	Structures with light-frame truss floor systems shall be marked with the letter "F."
--	--

	Structures with light-frame truss roofs shall be marked with the letter "R."
--	--

	Structures with light-frame truss floor and roof systems shall be marked with the letters "R/F."
--	--



For more information,
Contact the Groveland
Fire Department
at 352-429-1209

Light frame truss construction is defined as a type of construction whose primary roof or flooring structural elements is formed by a system of light gauge steel or repetitive wood, to include but not limited to, balconies, mezzanines, additions, or parts of the structure without any exemptions to size.