


PAVERS

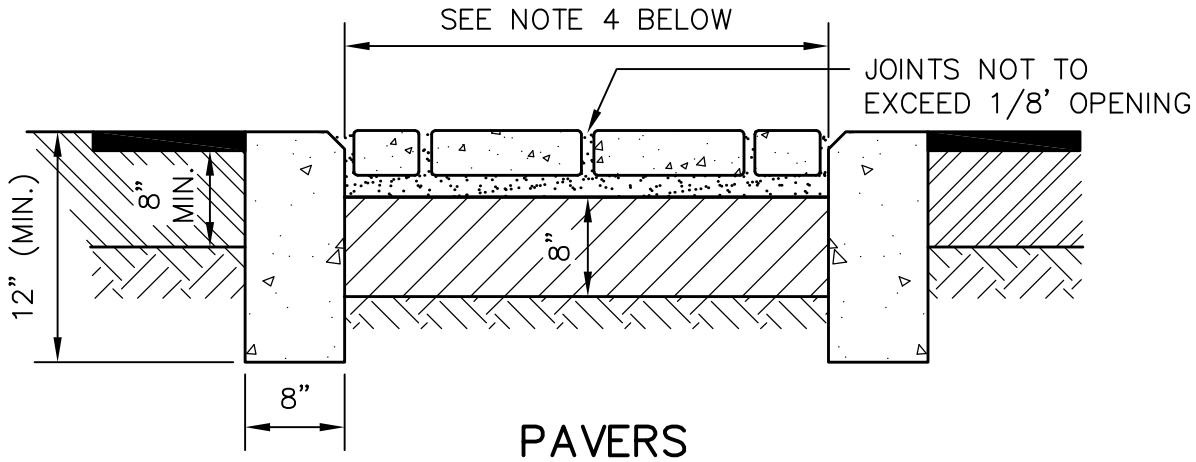


PATTERNED CONCRETE

NOTES:

1. WHEEL CHAIR RAMPS SHALL BE PROVIDED WHERE CROSSWALK MEETS SIDEWALKS AND CURBS.
2. PAVERS SHALL BE 3–1/8" MINIMUM THICKNESS BEDDED IN 1–1/2" MINIMUM OF SAND OR CRUSHED STONE SCREENINGS.
3. CONCRETE AND PAVER PATTERN AND COLOR SHALL BE DETERMINED BY CITY OF GROVELAND.
4. MINIMUM WIDTH OF CROSSWALKS SHALL BE 5 FEET.
5. SEE STREET SECTIONS FOR BASE AND SUB–BASE REQUIREMENTS.

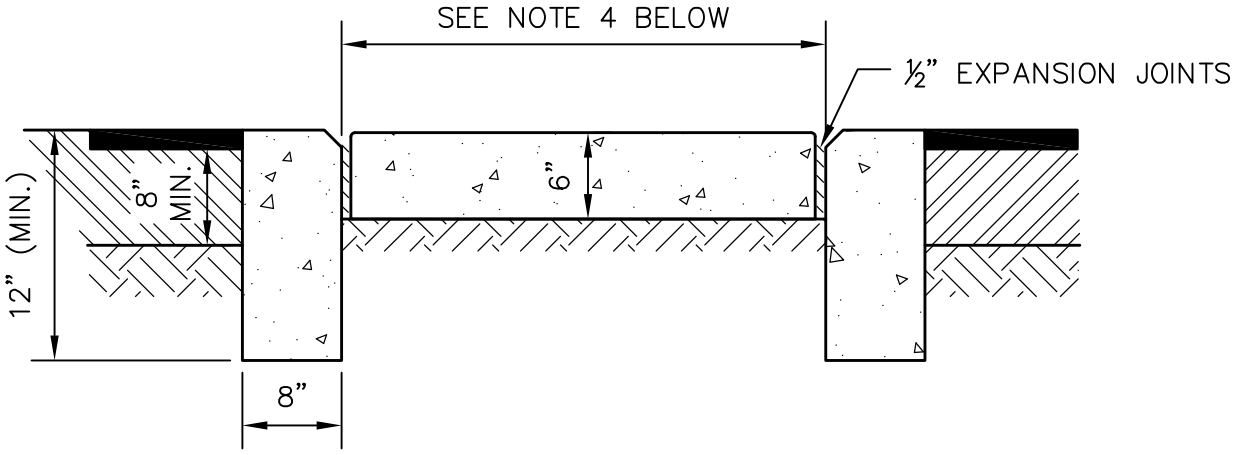


METZGER & WILLARD, INC.
*Civil • Environmental Engineers • Surveyors*
8600 Hidden River Parkway, Suite 550
Tampa, Florida 33637 (813) 977–6005


# TYPICAL DETAILS FOR CROSSWALKS AND DECORATIVE PAVEMENT

DATE: JULY 7, 2008
SCALE: N.T.S.

D–5