


PLAN

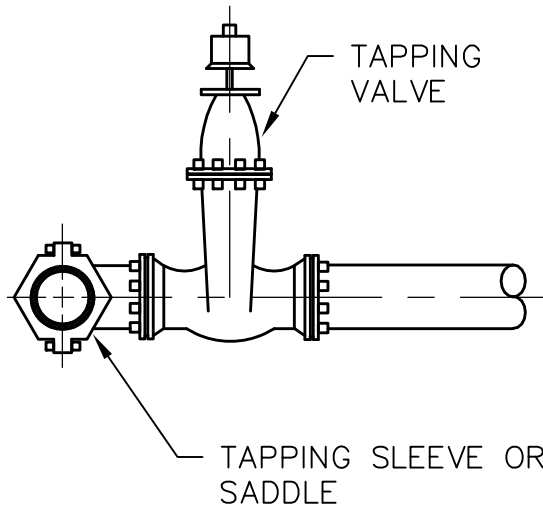

SIDE VIEW

NOTES:

1. TAPPING SLEEVE TO BE STAINLESS STEEL FOR 12" PIPE OR SMALLER, WITH PUBLIC WORKS DIRECTOR'S WRITTEN APPROVAL.
2. TAPPING SLEEVE OR SADDLE IS TO BE COMPLETELY WRAPPED WITH 8 MIL POLYETHYLENE ENCASEMENT.
3. TAPPING SLEEVE AND SADDLE SHALL BE TESTED AT A MINIMUM OF 150 PSI FOR A MINIMUM OF 15 MINUTES WITH NO VISIBLE LEAKAGE.
4. SIZE ON SIZE TAPS SHALL REQUIRE FULLY ENCAPSULATED SPLIT TAPPING SLEEVES, WITH MECHANICAL JOINT FLANGED.

CITY OF GROVELAND STANDARD DETAILS: RECLAIMED WATER



METZGER & WILLARD, INC.
Civil • Environmental Engineers • Surveyors
 8600 Hidden River Parkway, Suite 550
 Tampa, Florida 33637 (813) 977-6005

**TAPPING SLEEVE/SADDLE
 DETAIL**

DATE: JULY 7, 2008
 SCALE: N.T.S.

R-3